
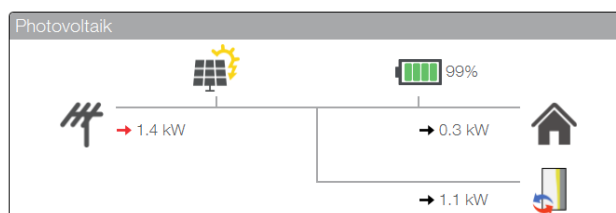


2.2.9. Communication with SMA Datamanager

When communicating with the SMA Datamanager, it is important that the heat pump and the Datamanager are in the same network. Communication between the heat pump and Datamanager takes place automatically via the network (Datamanager protocol / port 502). The surplus electricity is used for domestic hot water preparation, heat storage and heating management.

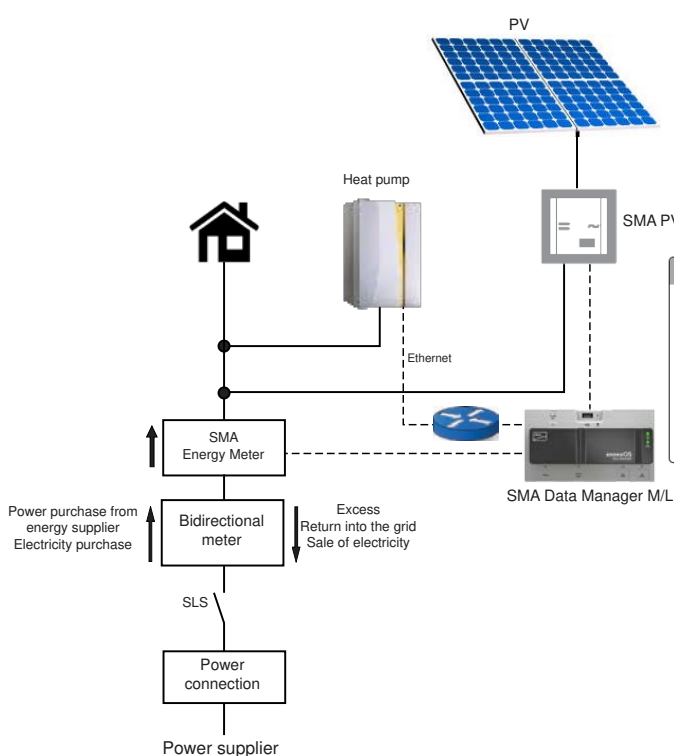

! „Enable Modbus Server“ must be checked in the Data Manager.

i The SMA Energy Meter is absolutely necessary for communication between the iDM heat pump and the SMA Datamanager M or L!
The IP address of the SMA Datamanager must be set in the navigator control!

! Communication with the „SMA Sunny Home Manager“ is not possible!
The SMA Datamanager M Lite does not work in conjunction with systems with battery storage!